


# KOHLER GENERATOR PAD (48kw-60kw)

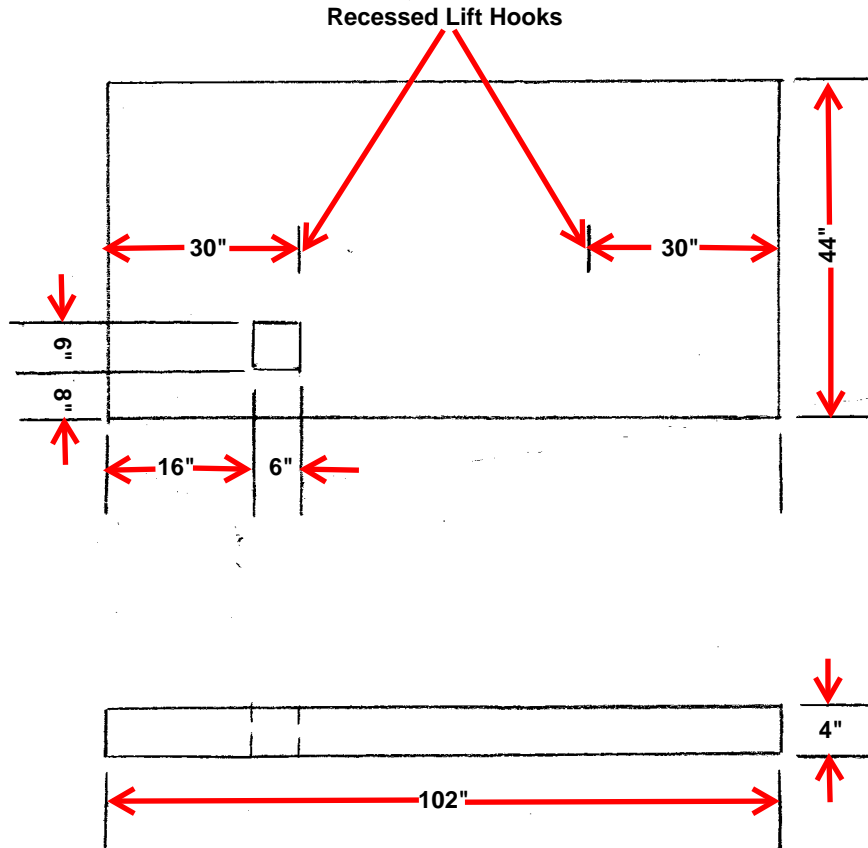

Drawing Date: 11/4/19

## Specifications:

- Concrete Minimum Compressive Strength- 4,000 psi @ 28 days
- Concrete Air Entrainment: 4%-9%
- Type I, or Type I/II Cement
- Steel Reinforcement:
  - Welded Wire Mesh 4" x 4" x W4/W4 ASTM-185, or equal
- Fiber Mesh Reinforcement ASTM C-1116 @ a Rate of 4.0 lbs/cy
- Approximate Weight= ~~XXXXXX~~ 1,400 LBS`
- Cast-in Utility Anchors Where Needed, for Handling

Eastern Precast Co., Inc.  
 2 Commerce Drive  
 Brookfield, CT 06804  
 P: (203) 775-0230  
 F: (203) 740-2059  
 rditullio@snet.net