


H-20 OIL SEPERATOR


SPECIFICATIONS:

- * Concrete Minimum Strength-5,000 PSI at 28 Days.
- * Steel Reinforcement - DB 4" x 4" Grade 60 Or Equal.
- * Epoxy Coated Inside.
- * Polymer Coated Outside.
- * Construction Joint Sealed With Butyl Sealant.
- * Construction Joint On 1000 Gallon Is Above Static Liquid Level. Construction Joint On Larger Sizes Is Below Static Liquid Level.

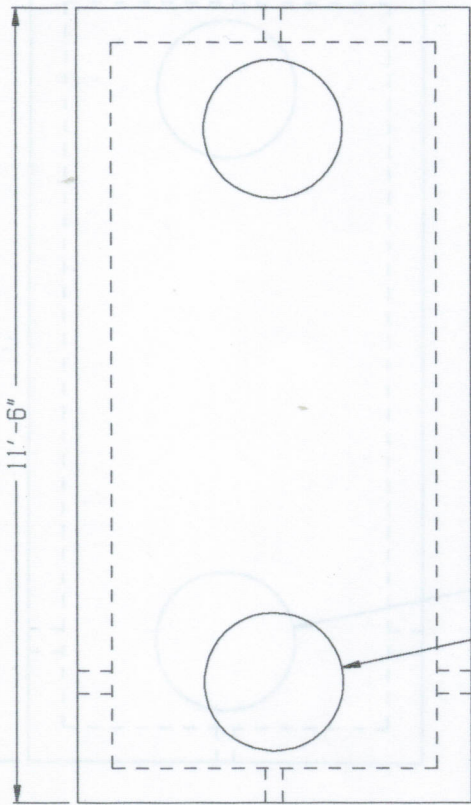


$\varnothing 24''$ TYP.

OUTLET BAFFLE

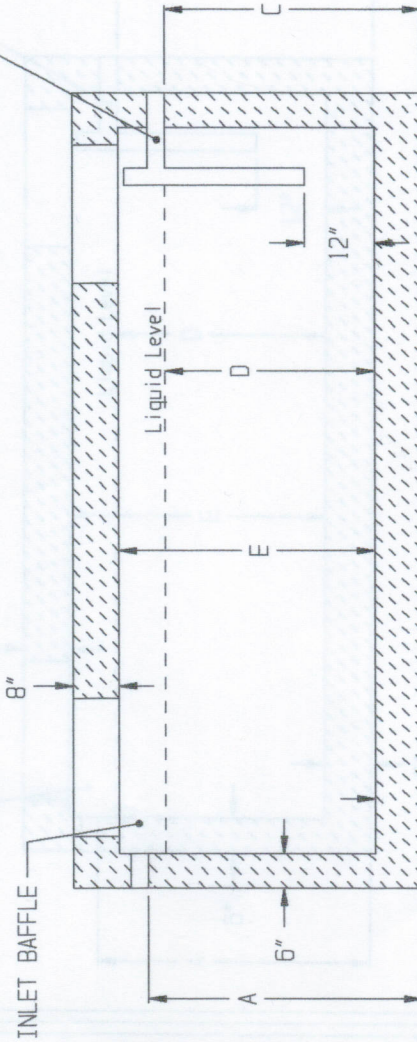

INLET BAFFLE

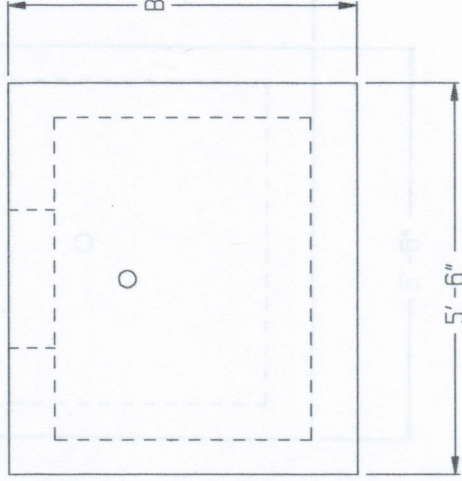

Tank Capacity	A	B	C	D	E
	Inlet Hgt.	D.A. Hgt.	Outlet Hgt.	Liquid Level	Inside Hgt.
1000	47"	61"	44"	36"	45"
1250	56"	70"	53"	45"	54"
1500	66"	79"	63"	55"	63"
2000	82"	95"	79"	71"	79"
2500	102	115	99	91	99
3000	117"	130"	114"	106"	114"
3500	135"	148"	132"	124"	132"

DWG # DSH20

EASTERN PRECAST CO., INC.

P.O. Box 5133 2 Commerce Dr., Brookfield, CT 06804
 Phone (203) 775-0230 775-9380 Fax (203) 740-2059

