



SURVEY MONUMENT



TOP VIEW

"X" Impression

Lifting Cable

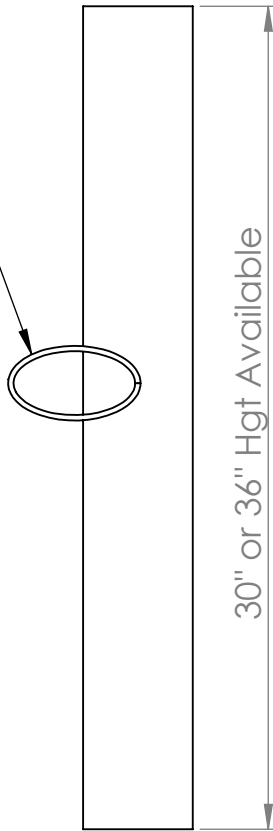

FRONT VIEW

Specifications:

- ⊗ Concrete Minimum Compressive Strength - 4,000 psi @ 28 days
- ⊗ Concrete Air Entrainment : 4% - 9%
- ⊗ Type I, or Type I/II Cement
- ⊗ Steel Reinforcement:
(1)#3 Deformed Bar (Gr.60) ASTM A-615 , Or equal.
- ⊗ Fiber Mesh Reinforcement
ASTM C- 1116 @ a Rate of 4.0 lbs/cy.
- ⊗ Approximate Weight:
30" Hgt = 44 LBS
36" Hgt = 53 LBS.

NOTES:



EASTERN PRECAST
 COMPANY, INCORPORATED
 2 COMMERCE DRIVE, BROOKFIELD, CT 06804
 TEL: 203-775-0230, FAX: 203-740-2059
 WWW.EASTERNPRECAST.COM

EP Survey Monument w/Lifting Loop.

MATERIAL :

DRAWN BY:	APPROVED BY:	DWNG DATE: 13.11.2024	TOLERANCE
		CHKD DATE: 13.11.2024	

MODEL NO.	
LOAD RATING	
REVISION 1 - DATE	
REVISION 2 - DATE	